



City of Spring Hill Fire Plan Example




- LEGEND**
- PROPERTY LINE
 - - - ADJACENT LOT LINE
 - EXISTING CURB
 - - - 500' EXISTING CONTOUR
 - W — EXISTING WATER MAIN
 - W — EXISTING WATER VALVE
 - W — EXISTING FIRE HYDRANT
 - S — EXISTING SANITARY SEWER MAIN
 - OE — EXISTING OVERHEAD ELECTRIC
 - UE — EXISTING UNDERGROUND ELECTRIC
 - EXISTING ROADWAY
 - GAS — EXISTING GAS LINE
 - T — EXISTING TELEPHONE LINE
 - W — PROPOSED WATER SERVICE
 - S — PROPOSED SEWER SERVICE
 - - - LIMIT OF FLOOD ZONE AE
 - - - ESA RIPARIAN BUFFER
 - x — x — WOOD SCREENING FENCE

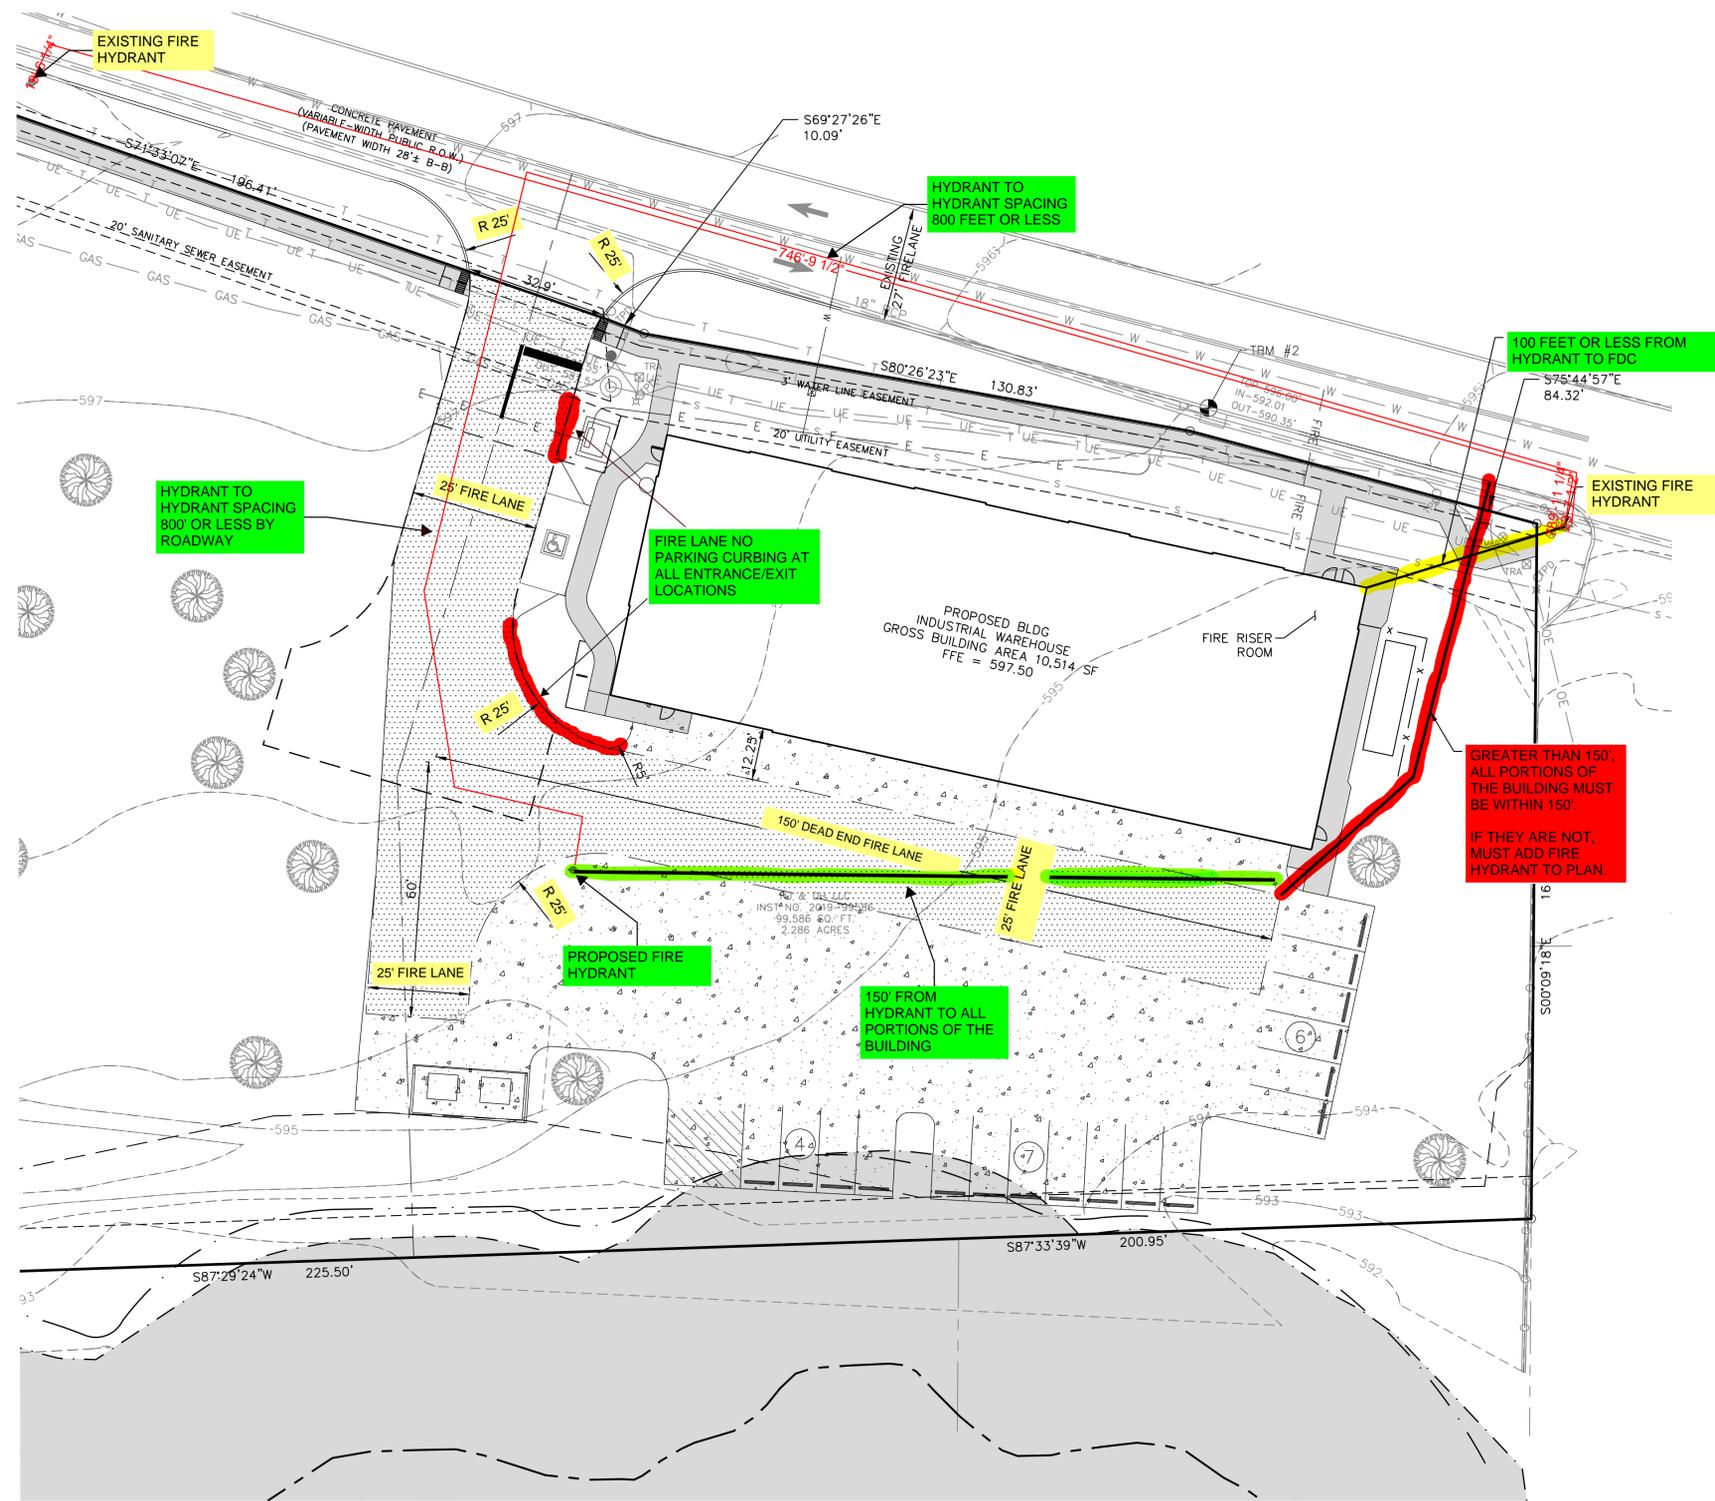


- ⊙ PROPOSED PARKING COUNT
- ▨ PROPOSED PAVEMENT
- ▨ FIRE LANE
- ⊙ EXISTING TREE

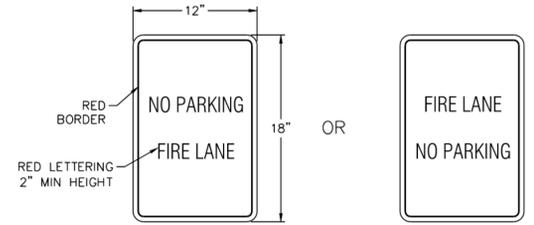

TYPICAL FIRE LANE SIGNAGE
NTS

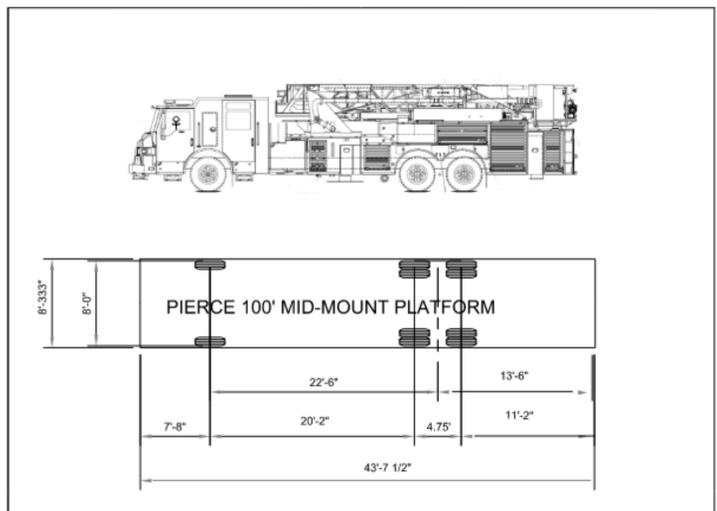

- APPARATUS AND TURNING INFORMATION**
1. NUMBER OF FRONT AXLES = 1
 2. FRONT TRACK WIDTH = 8.333 FT
 3. WHEELS ON EACH FRONT AXLE = 2
 4. NUMBER OF REAR AXLES = 2
 5. REAR TRACK WIDTH = 8.333 FT
 6. WHEELS ON EACH REAR AXLE = 4
 7. WHEELBASE = 22.6 FT
 8. REAR AXLE SPACING = 4.750 FT
 9. LOCK-TO-LOCK TIME = 6 SEC
 10. TURNING RADIUS WALL TO WALL = 43.4 FT
 11. BODY LENGTH = 43.750 FT
 12. BODY WIDTH = 8.333 FT
 13. REAR OVERHANG = 11.2 FT
 14. MINIMUM DESIGN SPEED = 5 MPH

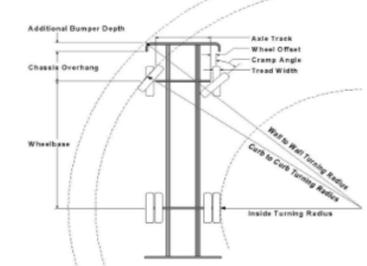

FIRE APPARATUS TURNING TEMPLATE

DWG. NO.
SD-7